

October 27, 2008  
Our Project Number: 11615

Xtreme Hard Densifier  
9924 Universal Blvd., Suite 224-115  
Orlando, FL 32819

**Attention: Brad Sleeper**

**PROJECT: Testing of Concrete Hardner  
Taber Abrasion Test ASTM C501**


Data:


Sample ID	Initial Mass (g)	Mass Remaining After Cycles					Remarks
		50	100	250	500	1000	
3A-1	193.59	191.44	190.30	188.08	185.40	181.19	
3A-2	186.99	184.16	183.07	181.09	178.93	175.73	
3A-3	242.75	240.00	239.35	237.51	235.49	232.96	
<b>Average Change (%)</b>		<b>1.252</b>	<b>1.732</b>	<b>2.720</b>	<b>3.844</b>	<b>5.487</b>	
3B-1	182.57	181.59	181.05	179.62	178.07	175.56	
3B-2	211.67	210.72	209.95	208.56	206.90	204.29	
3B-3	227.05	225.89	225.19	223.60	221.88	219.02	
<b>Average Change (%)</b>		<b>0.499</b>	<b>0.821</b>	<b>1.535</b>	<b>2.332</b>	<b>3.621</b>	

Sample #	Surface Treatment	Test Age
3A	Control	60 Days after casting
3B	Xtreme Hard	60 Days after casting

Comments:

- Wheel Type: H22
- Wheel Load: 1000g
- No. of cycles: 1000

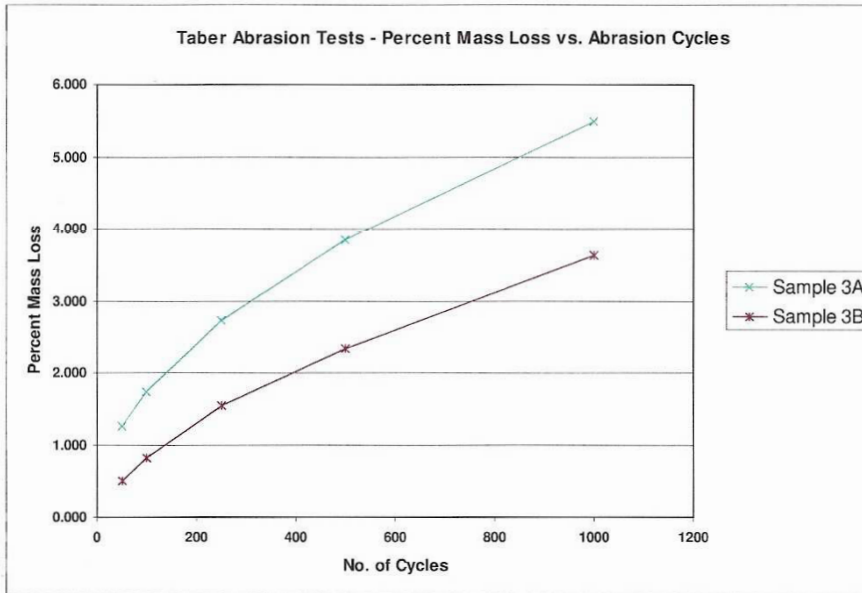

  
Association of Professional  
Engineers and Geoscientists  
of the Province of  
British Columbia  
P. V. JOSHI  
ENGINEERING  
LICENSEE  
Limited Licence  
131356

Per: Prakash Joshi, ASct, Eng.L.  
Senior Materials Engineering Technologist